


IE-500 Control Panel Reference Guide

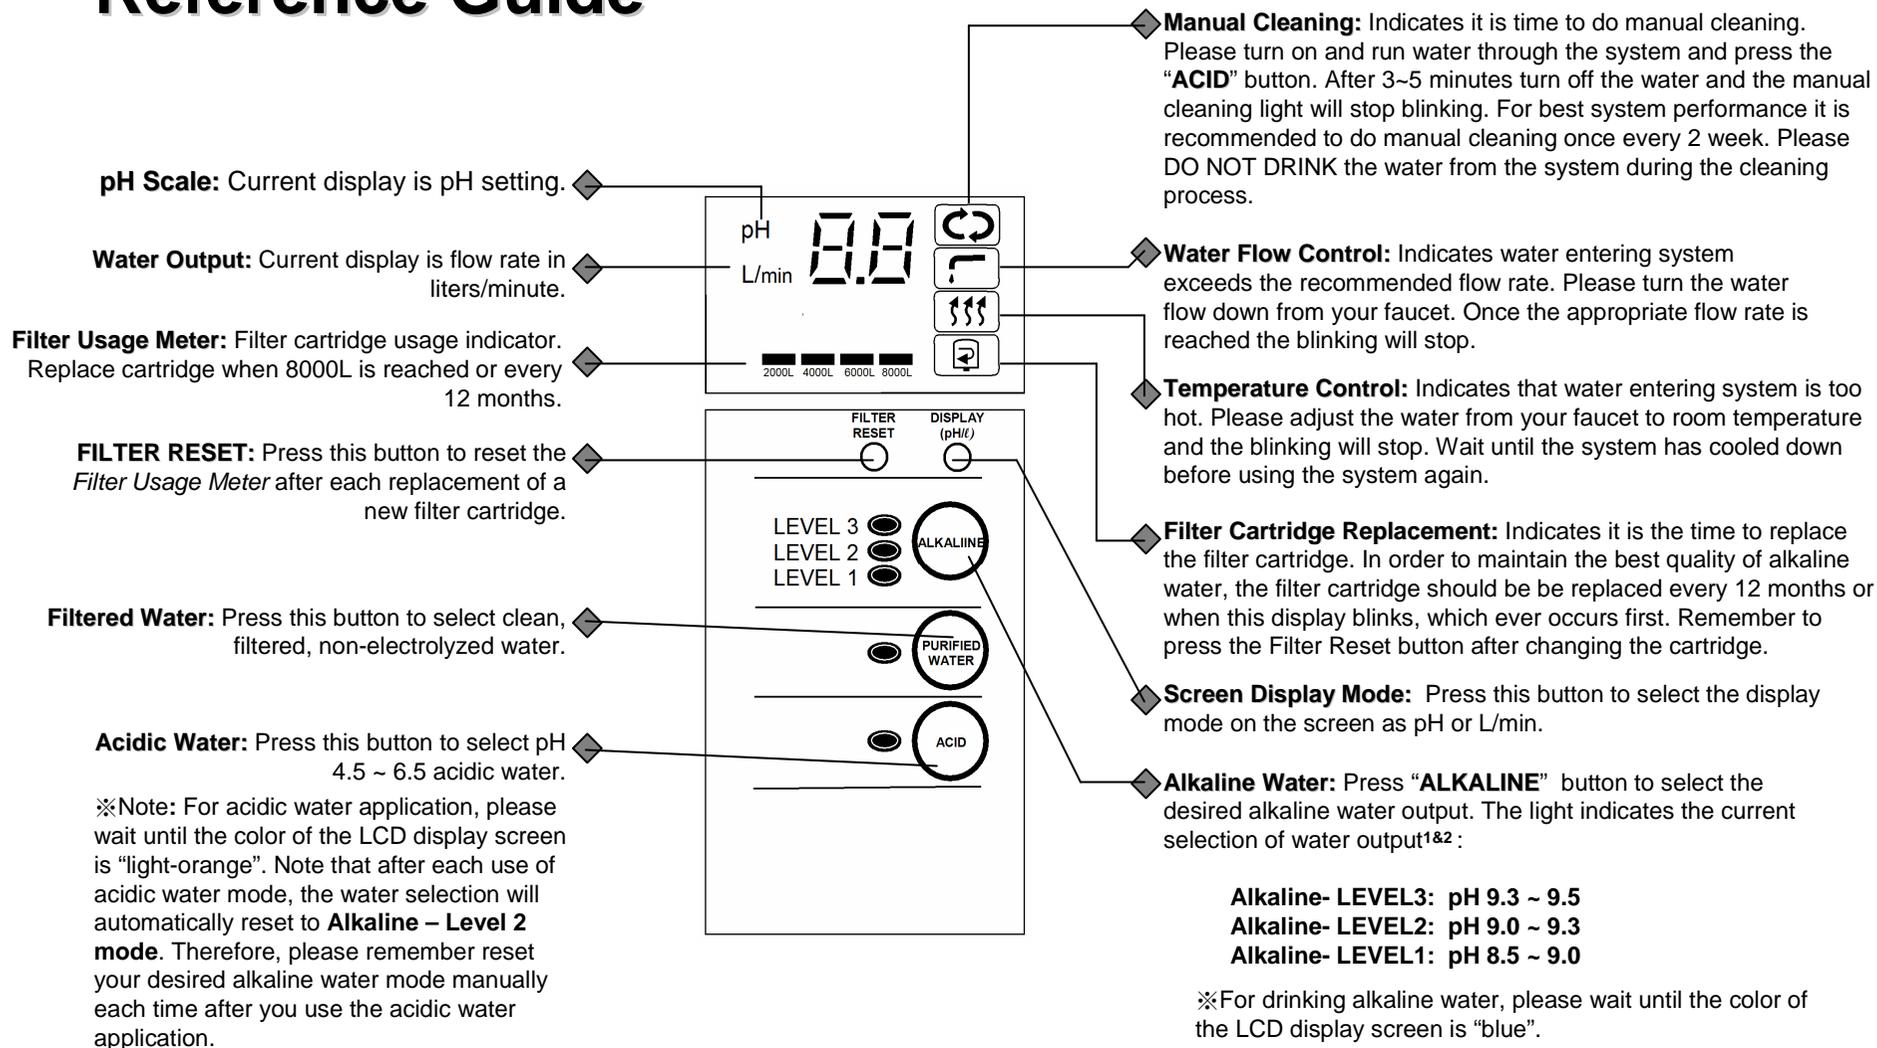

●Note 1: All pH levels are approximate, ± 0.25 depending on local water supply.
 ●Note 2: Water with pH <7.0 or >9.25 is not recommended for drinking.